PAD-M1

12"W x 15.75"H x 3"D (NOMINAL)

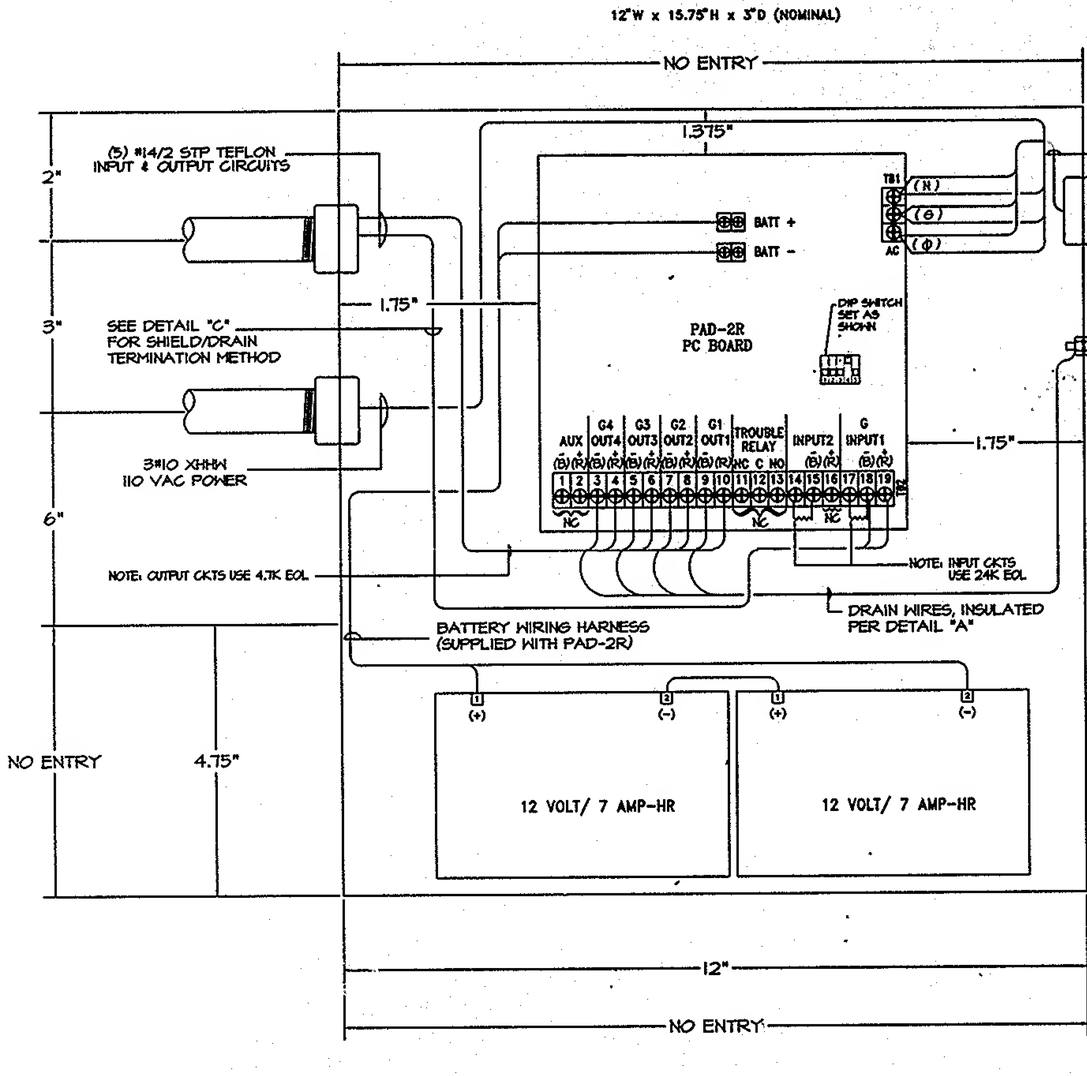

PAD-M

12"W x 15.75"H x 3"D

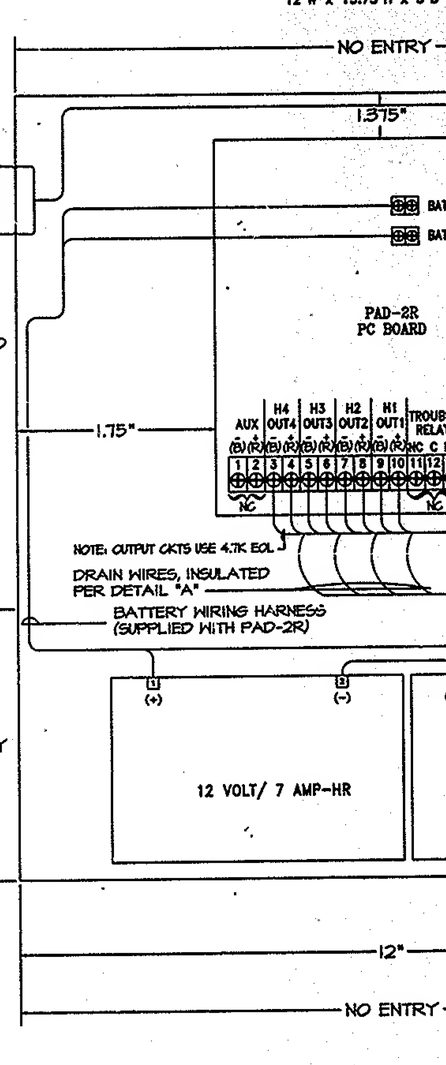

LEGEND	WIRING	NOTES
[illegible]	ALL MATERIALS UTILIZED SHALL BE APPROVED FOR USE BY THE ENGINEER. GROUNDING & BONDING REQUIRED - REFER TO P/A DRAWINGS. AC POWER WIRING SHALL BE #10 AWG (WHITE/NEUTRAL, BLACK/HOT, GREEN/GROUND) PER P/A SPECIFICATIONS & DRAWINGS HIGH LEVEL AUDIO, SPEAKER, CONTROL & SOLENOID CIRCUITS SHALL BE UNSHIELDED TWISTED PAIR (UTP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. LOW LEVEL AUDIO, METHORX, ALO, STRIDET, TELEPHONE CIRCUITS SHALL BE SHIELDED TWISTED PAIR (STP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. ALL WIRING DEVICES, TERMINALS, CONNECTORS ETC SHALL BE UL LISTED FOR THE TYPE WIRE USED, AND IN CONFORMANCE WITH P/A SPECIFICATIONS. #10 AWG REQUIRES APPROVED SOLID WIRE TERMINAL FOR CONNECTION USE PANDUIT MODEL # PNB-8F-D TERMINAL & PANDUIT MODEL # GT-950 CONTROLLED CYCLE INSTALLATION TOOL. EOL DEVICES SHALL BE 1/2 WATT RATED.	[illegible]

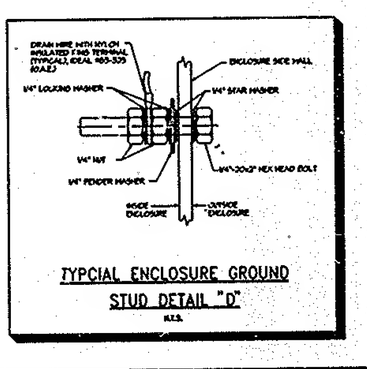

TYPICAL ENCLOSURE GROUND STUD DETAIL "D"

N.T.S.

FILE NAME: D:\DWG\HE-PLAZA\1-POWER\1st Basement level w+out specs and keynotes\alb power auto\Alb-pad-B1.dwg plotted on 5/1/1998 by Hakan